



Below is the weekly remote sensor data from 8/23/23 to 8/31/23. Dissolved oxygen (DO; in blue; Black dashed line indicates 5 mg/L) were acceptable at both stations. Chlorophyll concentrations (a proxy for microscopic algal biomass, in green) were acceptable at Seabridge (station 6) with normal daily oscillations observed. The instrument at Westport (station 7) failed on 8/26/2023, and the chlorophyll data obtained from 8/23/23 – 8/26/23 at Westport was likely erroneous.

The City of Oxnard and Aquatic Bioassay & Consulting will continue to monitor the sensors in the area.


Logger 062554 – Located at Seabridge (Station 6)

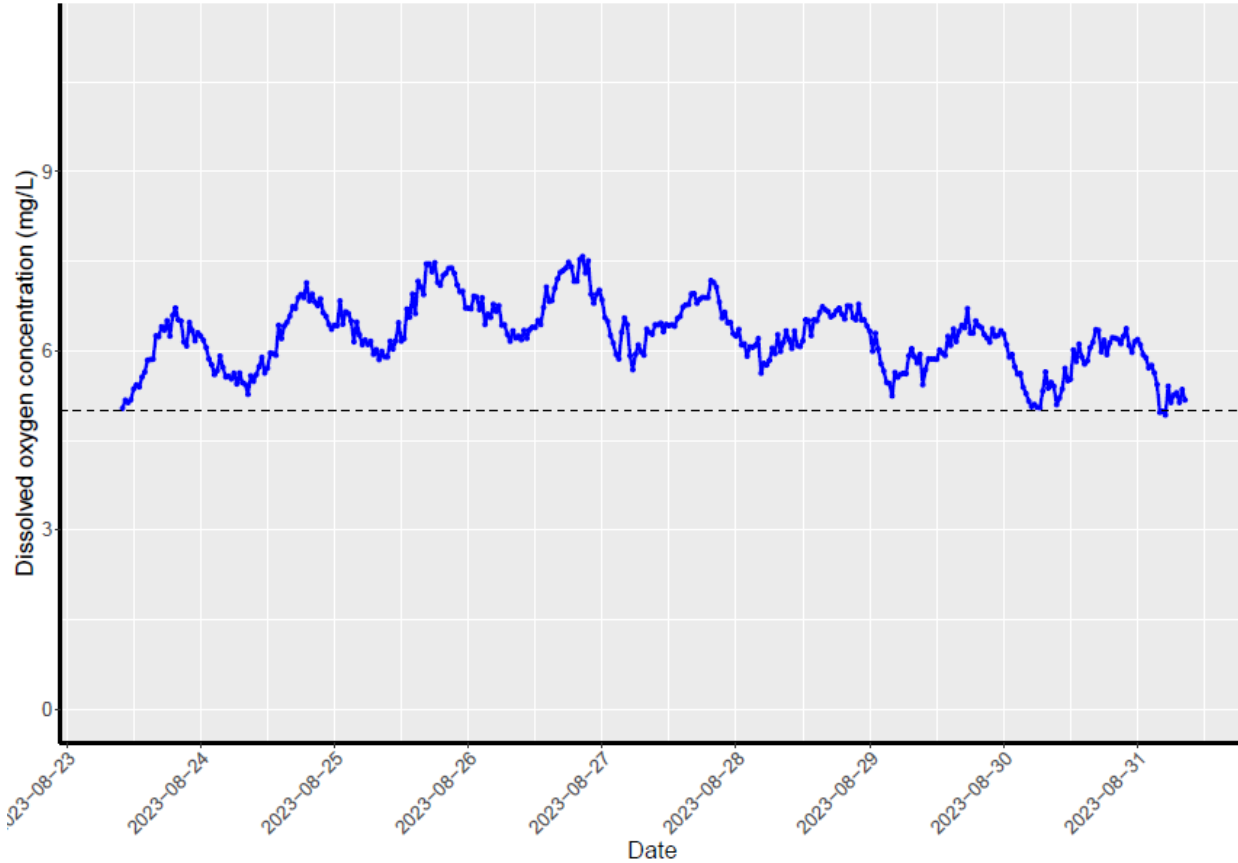

Logger 062556 – Located at Westport (Station 7)

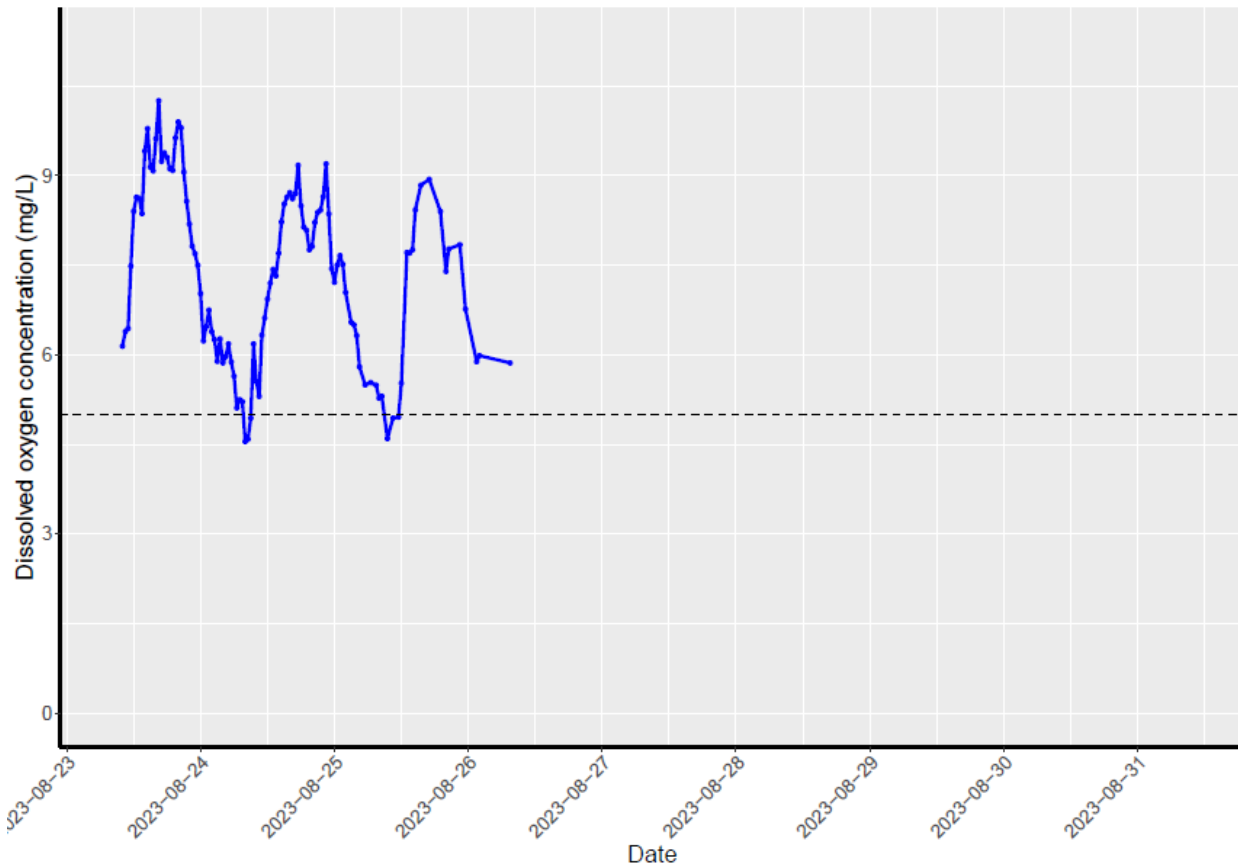

Logger 062554 – Located at Seabridge (Station 6)

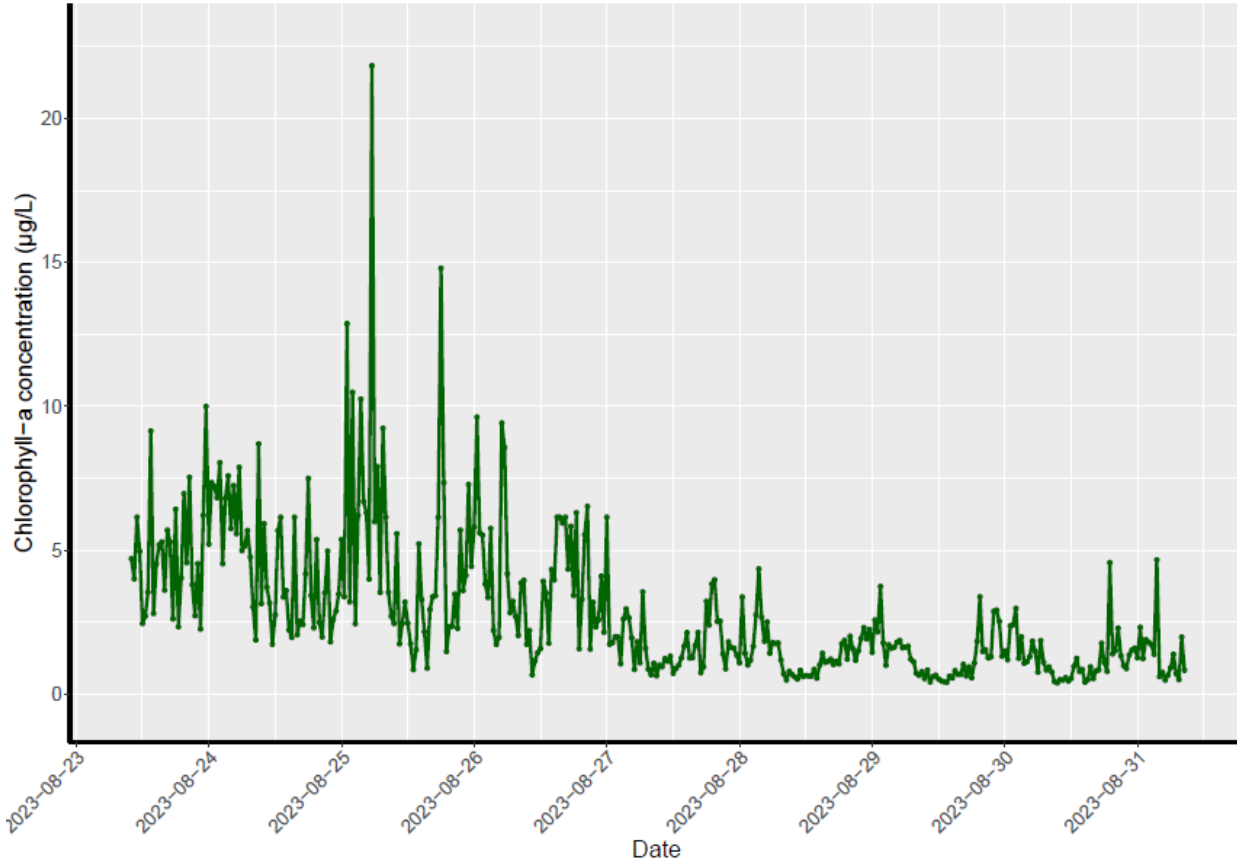

Logger 062556 – Located at Westport (Station 7)

