



Below is the weekly remote sensor data from 9/26/23 to 10/3/23. Dissolved oxygen (DO; in blue; Black dashed line indicates 5 mg/L) went below 5 mg/L for short periods (hours) at both stations. Chlorophyll concentrations (a proxy for microscopic algal biomass, in green) were acceptable at both stations with normal daily oscillations observed.

The City of Oxnard and Aquatic Bioassay & Consulting will continue to monitor the sensors in the area.


Logger 062554 – Located at Seabridge (Station 6)

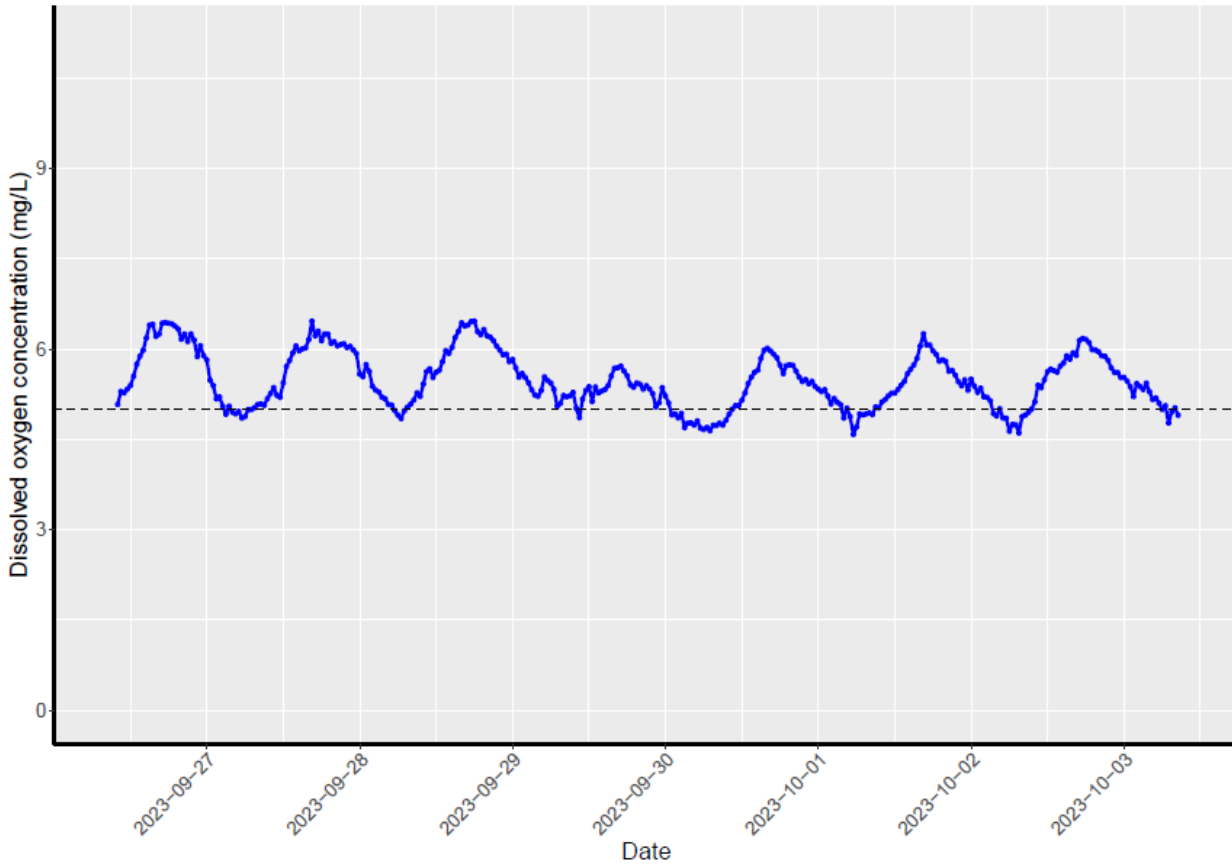

Logger 062555 – Located at Westport (Station 7)

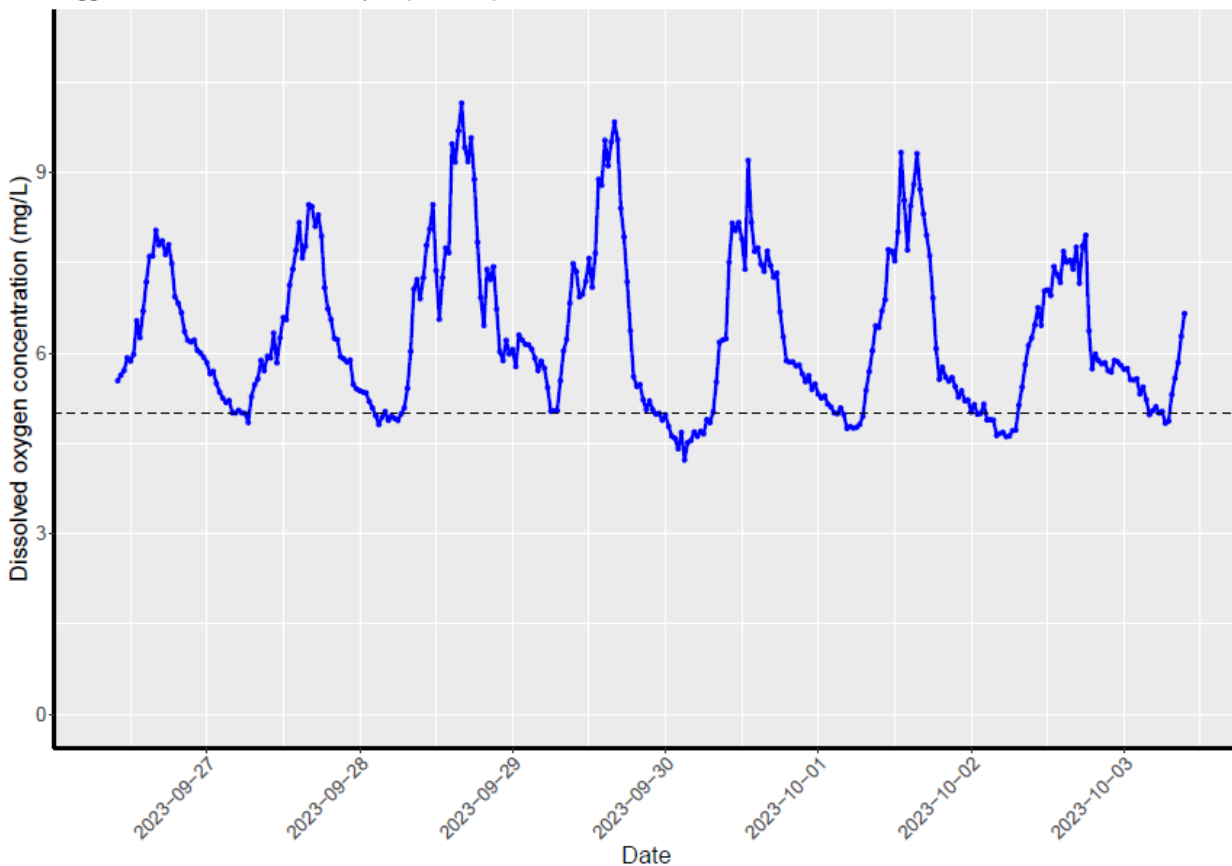

Logger 062554 – Located at Seabridge (Station 6)

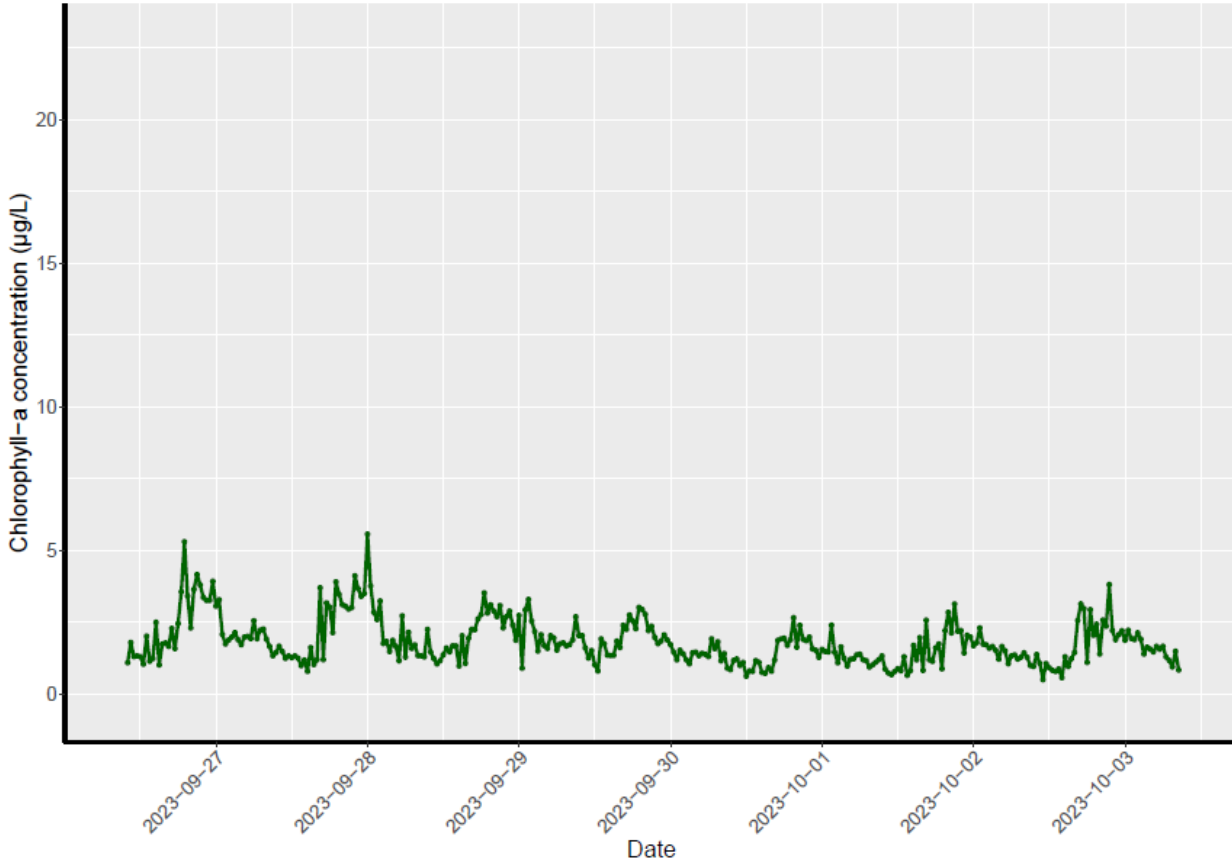

Logger 062555 – Located at Westport (Station 7)

